8891-1774-1629-1865

TEST REPORT

COPY 복사본

1. NO : CT22-123063E
2. Client
   - ○ Name : SEOHAN ANTAMIN
   - ○ Address : 51st 622 Angogae-ro, Namdong-gu, Incheon
3. Date of Test : 2022.12.20 ~ 2023.02.27
4. Use of Report :
5. Test Sample : AOP 8T
6. Test Method
   (1) KS D 9502:2020[NSS]
   (2) KS F 3504:2018
   (3) KS F 3200:2021

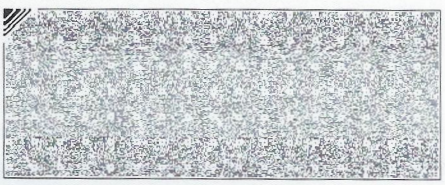
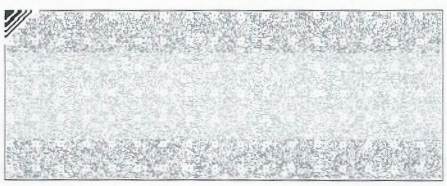
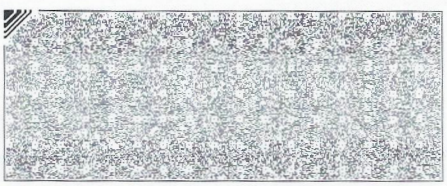
Affirmation	Tested By Name : Lim Jonghui Lim jonghui	Technical Manager Name : Kang, Mun Sik

This report is not accredited by KOLAS and KS Q ISO/IEC 17025.
Our report apply only to the standards or procedures identified and to the sample(s) tested unless otherwise specified. The test results are not indicative of representative of the qualities of the lot from which the sample was taken or of apparently identical or similar products. The results of using only a portion of this report cannot be guaranteed. The authenticity of this test report can be checked on KCL website(www.kcl.re.kr).

2023.02.27

Korea Conformity Laboratories President Jo, Yung Tae

Result Inquiry : 85, Dambang-ro, Namdong-gu, Incheon, Korea (82-32-460-5152)

TEST REPORT

No : CT22-123063E

7. Test Results

1) AOP 8T

Test Item(s)	Unit	Test Method	Test Results	Remark	Loc.
Salt spray test (1 000 h)	-	(1)	No corrosion	-	A
Bending Strength[Length]	N	(2)	2 872		B
Bending Strength[Width]	N	(2)	2 341		
Water absorption	%	(3)	0.2		A
Stain resistance	scale	(3)	(4-5)		
Impact resistance - appearance	-	(3)	Pass		
Impact resistance - diameter of crater	mm	(3)	0		

※ Location

A : 85, Dambang-ro, Namdong-gu, Incheon, Korea

B : 73, Yangcheong 3-gil,Ochang-eup,Cheongwon-Gu,Cheongju-Si,Chungbuk,Korea

----- End of Report -----

COPY 복사본 KCL 복사본 COPY